


# SEGMENT D-E



NOT TO SCALE

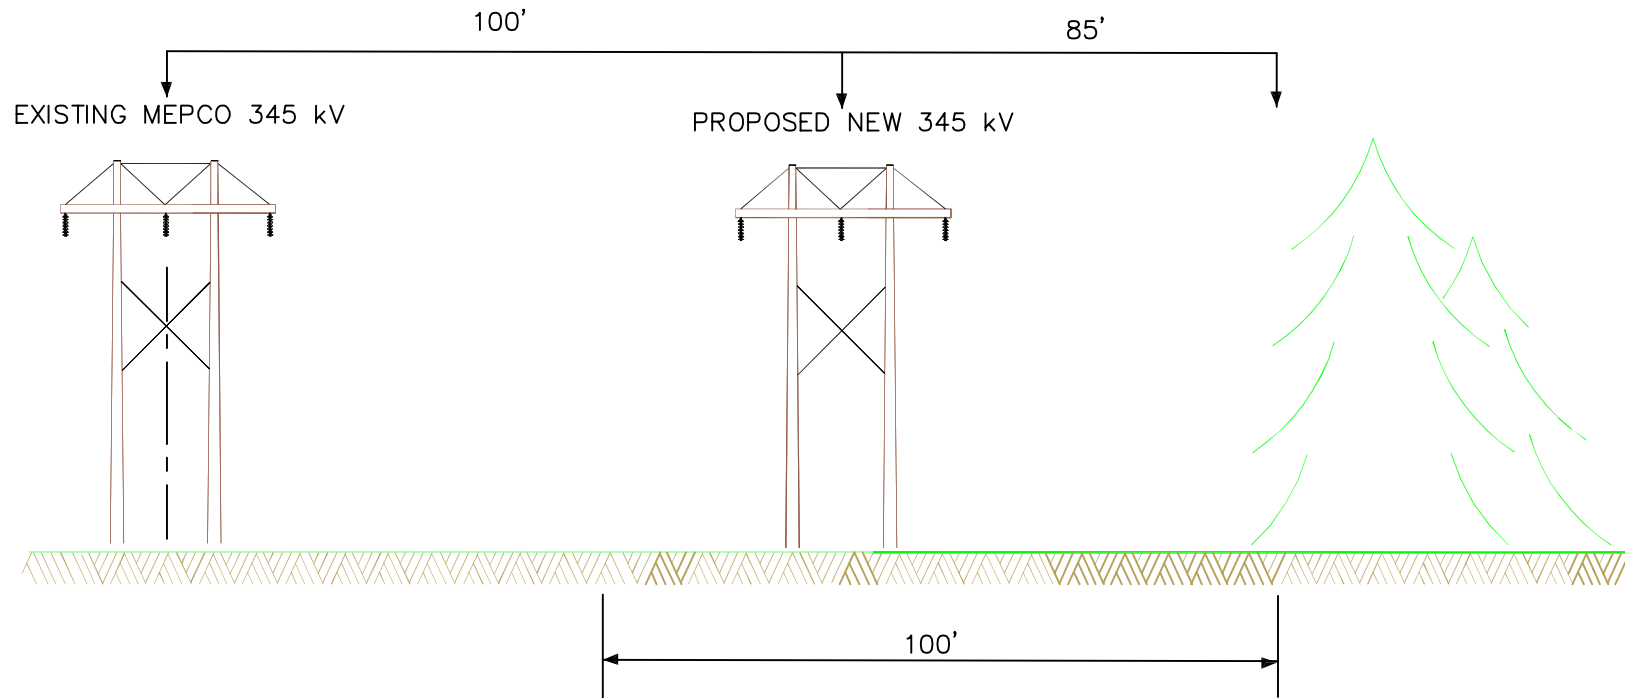

APPENDIX 1-3  
TYPICAL ROW CONFIGURATION  
ALONG EXISTING MEPCO ROW  
BANGOR HYDRO-ELECTRIC COMPANY  
NORTHEAST RELIABILITY INTERCONNECT